


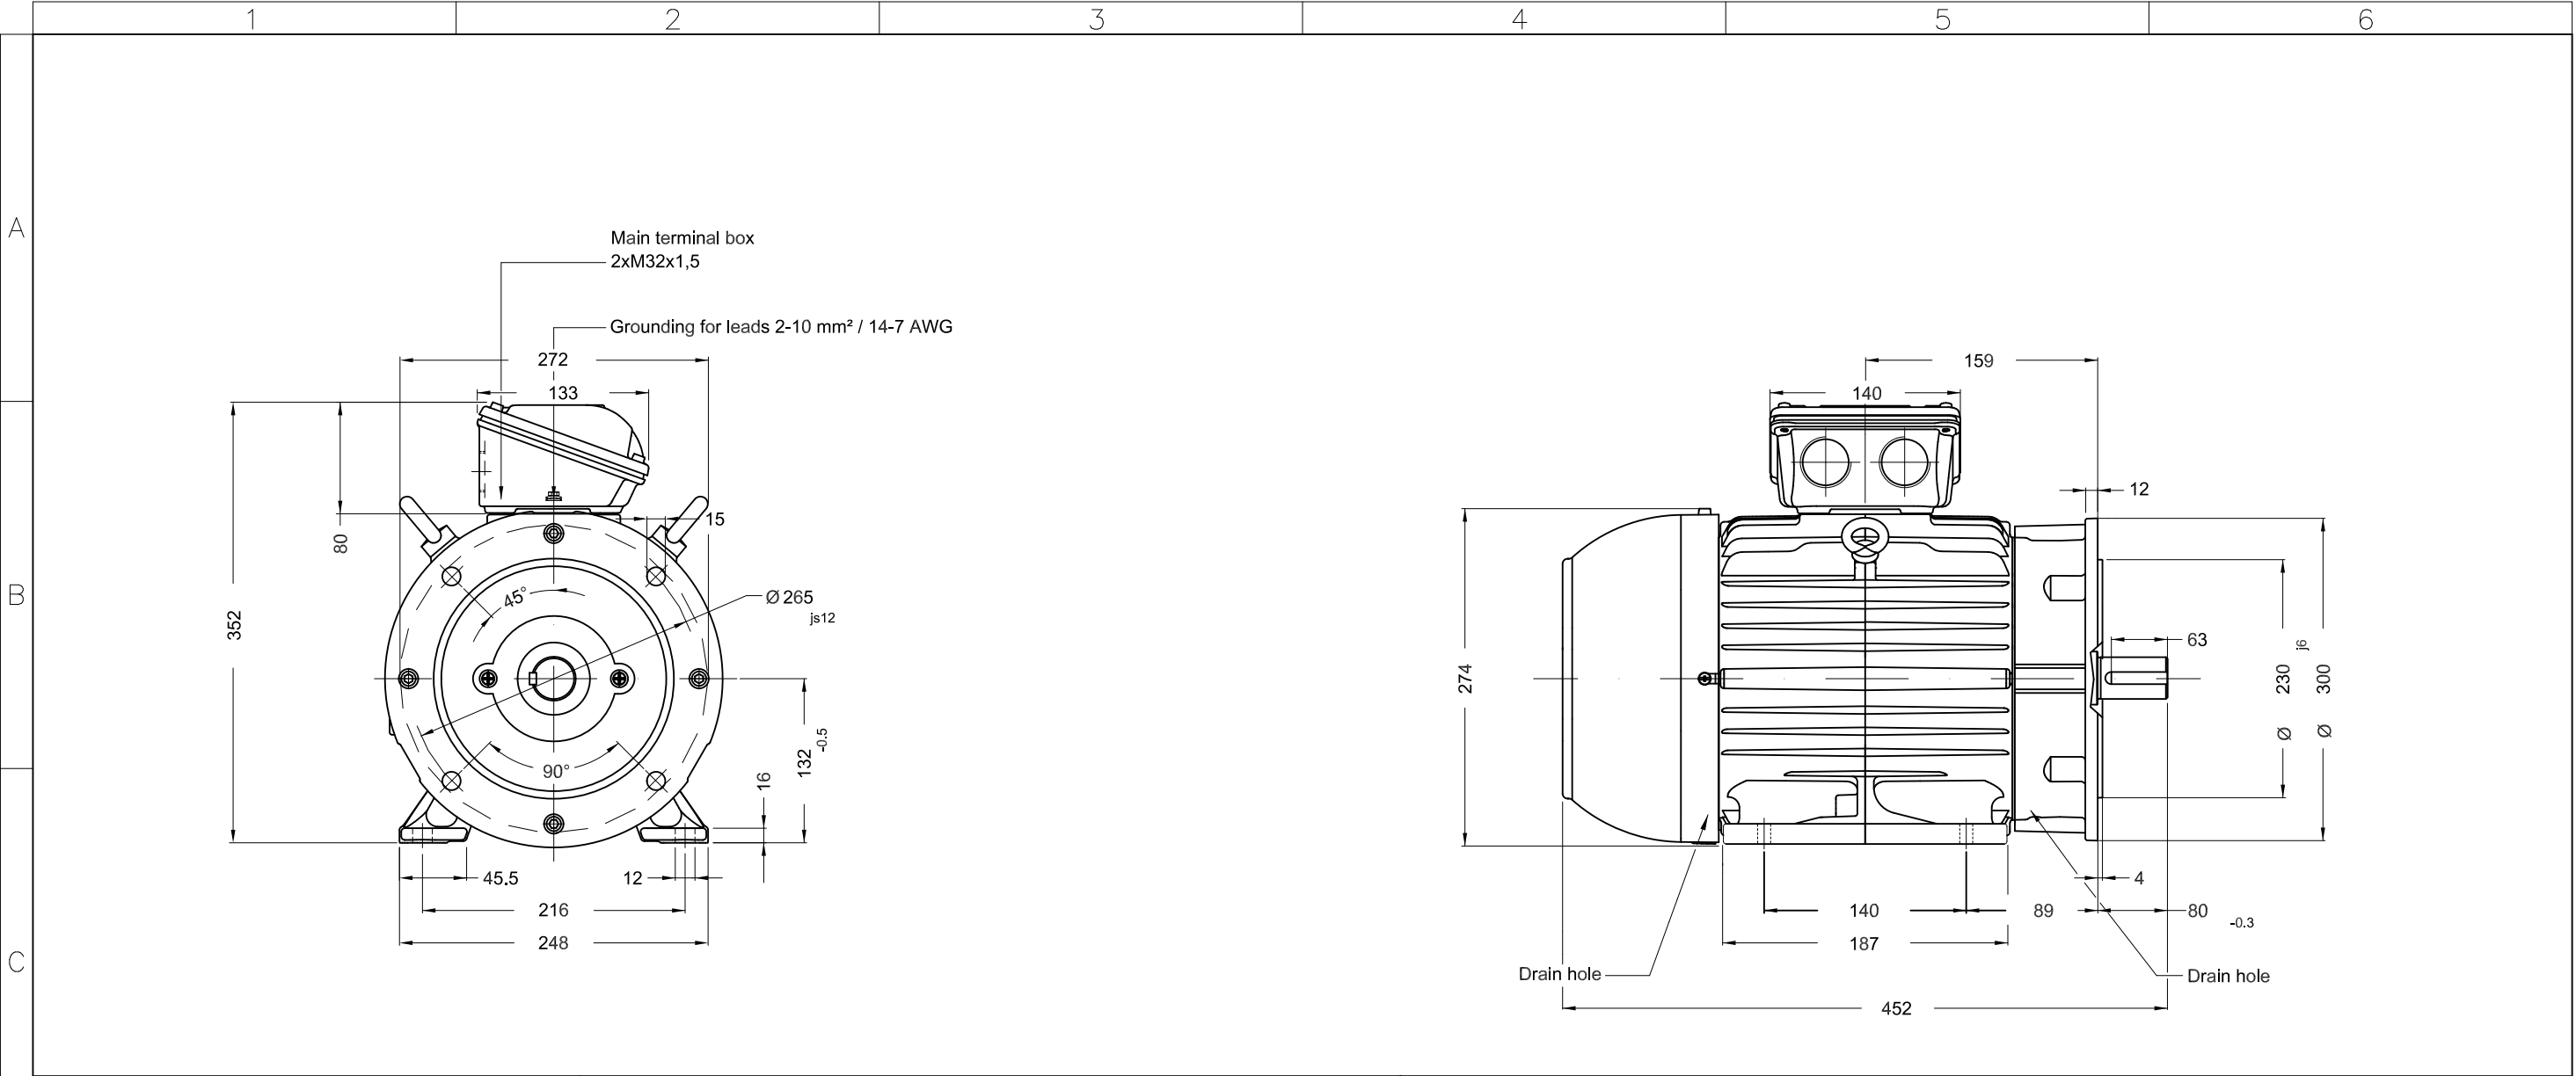

D				5.5 kW 02 Poles 50 Hz										A	
E		DE Shaft End		ECM		LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER	
				EXECUTED	USERADMIN			THREE PHASE W22 MOTOR - PREMIUM EFF FRAME 132S IP55 TEFC			PREVIEW WDD				
				CHECKED											
				RELEASED											
				REL DT.			WMO	Jaragua do Sul			Product Engineering		SHEET		1 / 1