


Outlet leads on left side when looking at shaft end
 Mounting B34T

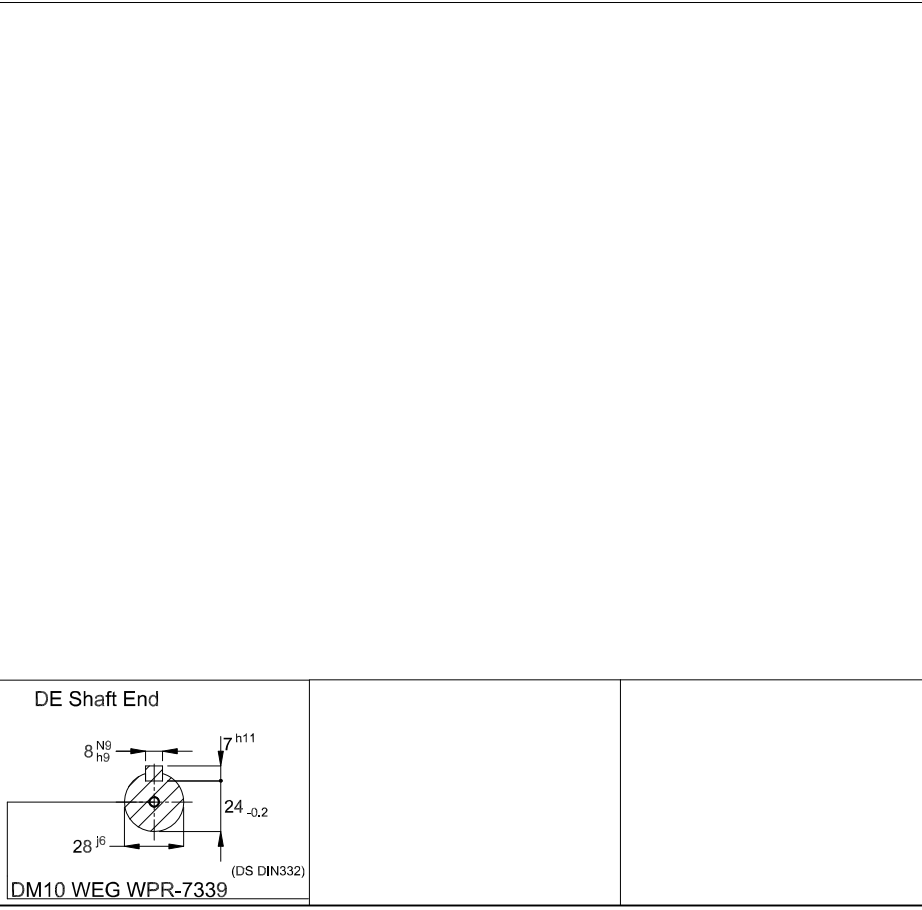

2.2 kW 04 Poles 50 Hz										A	
Scale 1 : 5											
PIRWUSER										00	
ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	PIRWUSER	SINGLE PH. MOTOR W22 IE2					PREVIEW				
CHECKED		FRAME 100L IP55 TEFC					WDD 00				
RELEASED							SHEET		1 / 1		
REL. DATE		WEG REDDITCH					[Operational]				